

Product Overview & Application Examples





Time Relays



Auxiliary Relays



Power Supplies



Signal & Control Modules

Monitoring Relays



Wi-Fi-Enabled Relays



Installation Contactors





Time Relays



CRM-91H

Multifunction time relay
10 functions
time range 0.1s - 10days
1x16A changeover



CRM-181J

Single-function time relay
1 function
time range 0.1s - 100h
1x16A changeover



CRM-2T

Star / Delta time relay
1 function
time range t1: 0.1s - 100days, t2: 0.1-1s
2x16A changeover



PTRM-216KP

Multifunction time relay
potential-free control input
11 pin octal socket
10 functions
time range 0.05s - 30days
2x16A changeover



CRM-2H

Asymmetric flasher
2 functions
time range 0.1s - 100days
1x16A changeover



DIN Relay Connectors Explained




CRM-181J
Single-function time relay

On delay / Off Delay /
Interval On / Flasher

time range 0.1 s - 100 h
1x16A changeover

CRM-181J

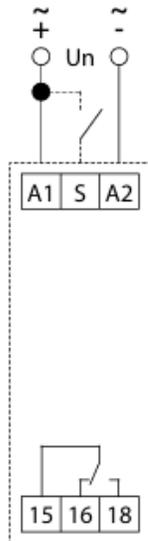


CRM-183J
Single-function time relay

On delay / Off Delay /
Interval On / Flasher

time range 0.1 s - 100 h
3x8A changeover

CRM-183J

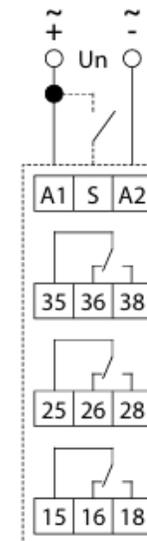




On Delay Function Example



CRM-181J
Single-function time relay


ON DELAY / Off Delay /
Interval On / Flasher

time range 0.1 s - 100 h
1x16A changeover




ON DELAY
When the input voltage U is applied, timing delay t begins. Relay contacts R change state after time delay is complete. Contacts R return to their shelf state when input voltage U is removed. Trigger switch is not used in this function.


Delayed motor start



Timer starts



Time expires

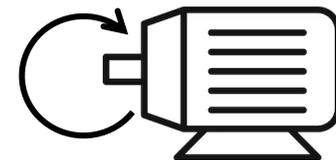




Off Delay Function Example



CRM-181J Single-function time relay

On Delay / **OFF DELAY** /
Interval On / Flasher



time range 0.1 s - 100 h
1x16A changeover




OFF DELAY

Input voltage U must be applied continuously. When trigger switch S is closed, relay contacts R change state. When trigger switch S is opened, delay t begins. When delay t is complete, contacts R return to their shelf state. If trigger switch S is closed before time delay t is complete, then time is reset. When trigger switch S is opened, the delay begins again, and relay contacts R remain in their energized state. If input voltage U is removed, relay contacts R return to their shelf state.


Extended fan operation

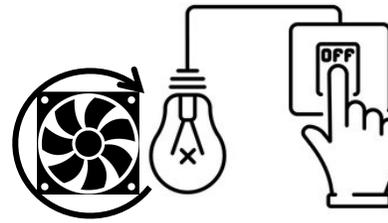

Timer starts



Time expires



OFF



Multifunction Relays



CRM-91H


Multifunction time relay
10 functions
time range 0.1s - 10days
1x16A changeover



ON DELAY
When the input voltage U is applied, timing delay t begins. Relay contacts R change state after time delay is complete. Contacts R return to their shelf state when input voltage U is removed. Trigger switch is not used in this function.




INTERVAL ON
When input voltage U is applied, relay contacts R change state immediately and timing cycle begins. When time delay is complete, contacts return to shelf state. When input voltage U is removed, contacts will also return to their shelf state. Trigger switch is not used in this function.




FLASHER - OFF first
When input voltage U is applied, time delay t begins. When time delay t is complete, relay contacts R change state for time delay t. This cycle will repeat until input voltage U is removed. Trigger switch is not used in this function.




FLASHER - ON first
When input voltage U is applied, relay contacts R change state immediately and time delay t begins. When time delay t is complete, contacts return to their shelf state for time delay t. This cycle will repeat until input voltage U is removed. Trigger switch is not used in this function.




OFF DELAY
Input voltage U must be applied continuously. When trigger switch S is closed, relay contacts R change state. When trigger switch S is opened, delay t begins. When delay t is complete, contacts R return to their shelf state. If trigger switch S is closed before time delay t is complete, then time is reset. When trigger switch S is opened, the delay begins again, and relay contacts R remain in their energized state. If input voltage U is removed, relay contacts R return to their shelf state.




SINGLE SHOT
Upon application of input voltage U, the relay is ready to accept trigger signal S. Upon application of the trigger signal S, the relay contacts R transfer and the preset time t begins. During time-out, the trigger signal S is ignored. The relay resets by applying the trigger switch S when the relay is not energized.




SINGLE SHOT falling edge
Upon application of input voltage U, the relay is ready to accept trigger signal S. Upon application of the trigger signal S, the relay contacts R transfer and the preset time t begins. At the end of the preset time t, the relay contacts R return to their normal condition unless the trigger switch S is opened and closed prior to time out t (before preset time elapses). Continuous cycling of the trigger switch S at a rate faster than the preset time will cause the relay contacts R to remain closed. If input voltage U is removed, relay contacts R return to their shelf state.



ON/OFF DELAY
Input voltage U must be applied continuously. When trigger switch S is closed, time delay t begins. When time delay t is complete, relay contacts R change state and remain transferred until trigger switch S is opened. If input voltage U is removed, relay contacts R return to their shelf state.



MEMORY LATCH
Input voltage U must be applied continuously. Output changes state with every trigger switch S closure. If input voltage U is removed, relay contacts R return to their shelf state.



PULSE GENERATOR
Upon application of input voltage U, a single output pulse of 0.5 seconds is delivered to relay after time delay t. Power must be removed and reapplied to repeat pulse. Trigger switch is not used in this function.



Time Relay Application Examples

- Flashing light control (time on, time off)
- Engine auto start control
- Furnace safety purge control
- Motor soft-start delay control
- Conveyor belt sequence delay
- Traffic light control
- Garage door and entrance control
- Elevators
- HVAC Systems





Monitoring Relays

Voltage Monitors



HRN3-80

Voltage monitoring relay in 3P
selectable range 208-480V
adjustable time delay 0.3-30s
2 outputs



HRN3-70

Voltage monitoring relay in 3P
selectable range 190-500V
adjustable time delay 0.3-30s
2 outputs

- Detect Voltage in a UPS cabinet to switch from utility power to batteries.
- Detect **overvoltage** in a control panel circuit to disconnect and protects other components.
- Detect **undervoltage** to stop a process and prevent unexpected stop and failure.
- Detects the **correct phase order** to prevent the motor running wrong direction.
- Detect **phase unbalance** to prevent the motor from overheating.



Monitoring Relays

Current Monitors



PRI-51

Current monitoring relay (1P)

ranges 0.1-1/2/5/8/16A AC; adjustable delay
monitoring by built-in transformer (7 ranges)
supply & output like PRI-32, but with direct
monitoring and finer ranges
higher sensitivity = better accuracy



PRI-32


Current monitoring relay (1P)

range 1-20A AC
monitoring by current transformer
(opening galvanic. separated, no heat loss),
adjust. current 1-20 A
multivoltage AC 24-240 and DC 24 V
output 8 A changeover
current transformer is a part of the product

Heating bars in sliding rails, heating cables, indication of current flow controlling of 1-phase motor consumption.

- Detects **current flow** - indicates operation of a heating cable.
- Detect **no current flow** - indicates a failure of a heating cable.
- Detect **overcurrent** - an industrial motor powering a conveyor belt that stalls. This relay can detect it and prevent motor damage.
- Monitors function of a light bulb (sport field, street lighting, mall, office building, elevators, public garage...

Monitoring Relay Application Examples

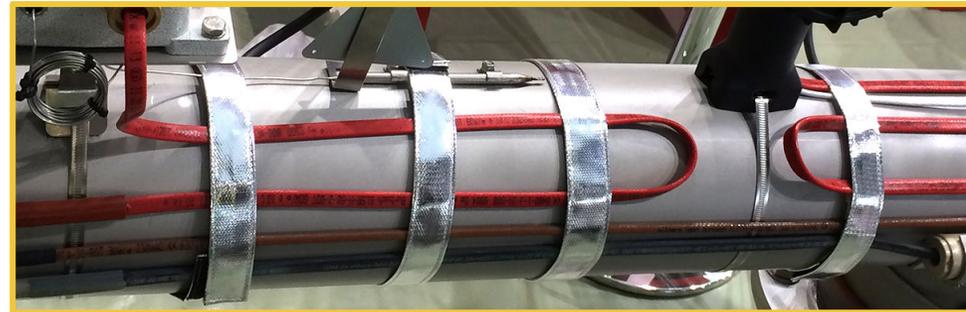



Auxiliary Relays

Installation Contactors



VS116U

Power relay
1x16A changeover,
1-module



VS120

Installation contactor
1x20A NO/NC



VS308U

Power relay
3x8A changeover
1-module




VS363


Installation contactor
3x63A NO

Auxiliary Relays


VS116U

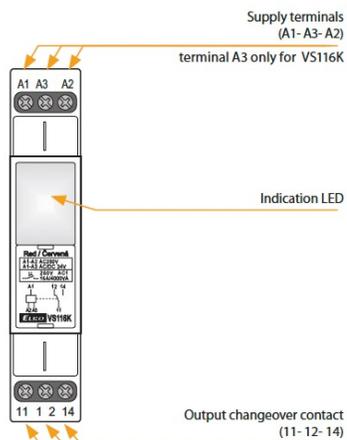


VS116U



VS308U

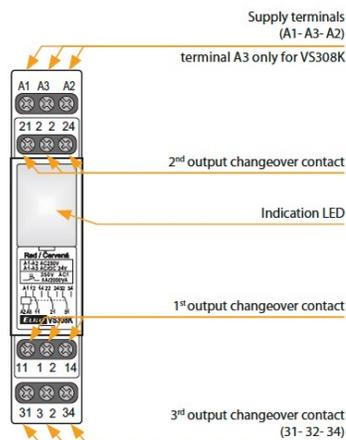

VS308U

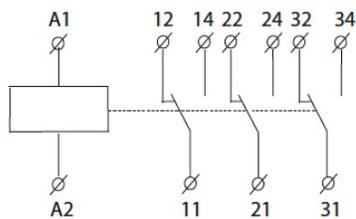

Universal control voltage
AC/DC 12-240V



VS116U
Power relay
1x16A changeover,
1-module



VS308U
Power relay
3x8A changeover
1-module



Power Supplies



PS3M

Power supply
DC 12V/54W
DC 24V/60W



PS1M

Power supply
DC 12V/15W
DC 24V/15W



PS4M

Power supply
DC 12V/85W
DC 24V/92W



PS2M

Power supply
DC 12V/24W
DC 24V/30W



PS6M

Power supply
DC 12V/135W
DC 24V/150W



Wi-Fi-Enabled Relays



SHT-13

Multifunction digital time switch

SHT-13/1

SHT-13/2

- Multiple programs in one device (daily, weekly, yearly and astronomical)
- UNiversal supply voltage in the range of AC/DC 24 - 240 V (AC 50-60 Hz)
- Simple setting after the first start-up
- User-replaceable battery to back up the set time during power outages
- Built-in web server for setup and control via Wi-Fi connection

- Time synchronization through NTP server (require internet connection)
- Possibility of permanent connection to the local network
- New well-arranged display with white backlight
- ASTROnomic program: manual entry of coordinates or selecting from one of more than 500 preset cities
 - selection of days of the week
 - astro interrupt function (night break): controls the sunrise/sunset times and compares them with the set OFF/ON times
 - high position accuracy thanks to two decimal places in latitude/longitude
- One/two channel design (each with an operating hours counter)
- Pulse/cycle output mode
- Transition of daylight-saving time - AUTO or OFF
- Sealable transparent front panel cover
- PIN code protection against unauthorized changes
- Wireless firmware update - current version 1.46



Signal & Control Modules

UL Certification Pending

USS-ZM

Base module

1-DIN case with contacts & terminals

- Independent switch units designed for flexible controlling and switching of power circuits
- Houses up to two switches or signal lights



5 YEAR WARRANTY



Examples of mounting



USS-01 + USS-03



USS-07 + USS-11



USS-11 + USS-01



USS-10 + USS-00



USS-10 + USS-11



USS-07 + USS-00

Switches with back-light

USS-07		8595188124713	
USS-08		8595188124720	
USS-09		8595188124706	

Switches, push buttons

USS-01		8595188124621	
USS-02		8595188124638	
USS-03		8595188124645	
USS-04		8595188124652	
USS-05		8595188124669	
USS-06/S		8595188124676	
USS-06/R		8595188136372	

Signaling lights

USS-10		8595188124331	
USS-11		8595188124348	
USS-12		8595188124355	
USS-13		8595188124362	
USS-14		8595188124898	
USS-15		8595188124379	



Monitoring Relays

UL Certification Pending



5 YEAR WARRANTY

HRH-XX

Level Switches
Multifunction
2-6 level monitoring



5 YEAR WARRANTY

HRF-XX

Frequency Monitors
Single-phase
40-480 Hz



5 YEAR WARRANTY

TER-XX

Thermostats / Temp. Monitors
Single/Multilevel
Programmable, Wi-Fi enabled



5 YEAR WARRANTY

PRI-XX

Current Monitors
Single/three-phase
Multifunction



Wi-Fi-Enabled Relays Application Examples


- **Electrical Panel production**
- Water Treatment and Management Systems
- Carwash lines
- Manufacturing plants
- Logistic centers, warehouses
- Mobile generators





PRODUCT APPLICATIONS

CAR WASHES

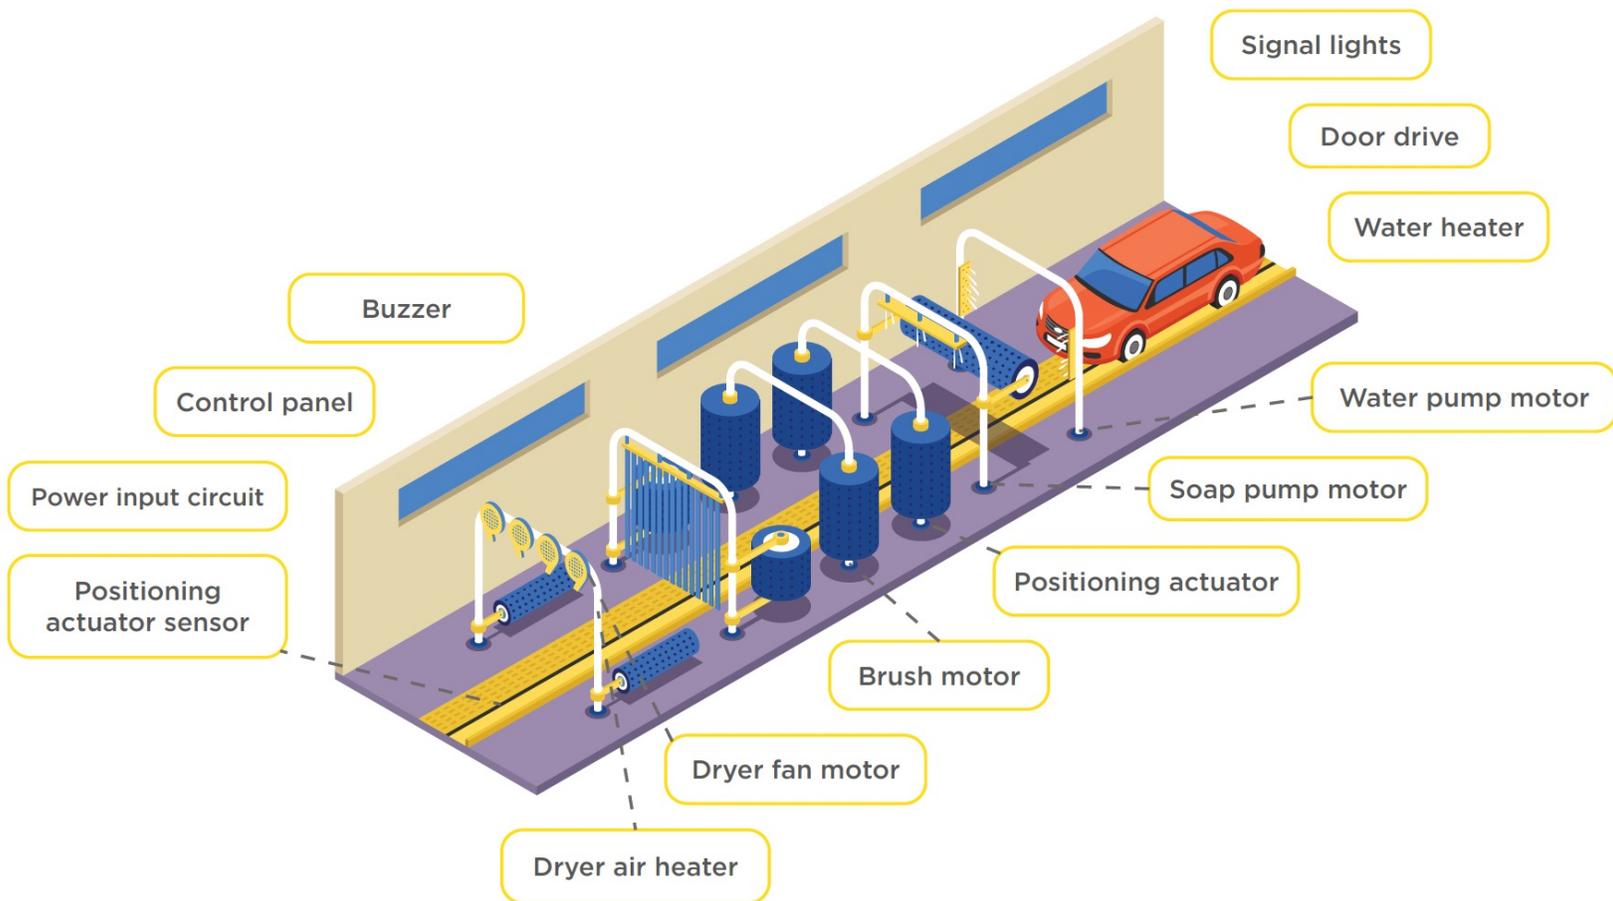


	Actuator sensor VS116U Relay stops actuator drive based on sensor signals.
	Brush motor VS340, CRM-181J, CRM-91H Relays time brush operation based on sensor signals.
	Buzzer CRM-181J Relay starts a warning buzzer for a pre-defined time interval.
	Control panel, Power input circuit VS463, HRN3-70 Contactor connects system to utility power, relay monitors voltage.
	Door drive VS220, CRM-181J, CRM-91H Relays control automatic door motion.
	Dryer air heater VS120, PRI-34, CRM-181J, CRM-91H Relays control, monitor and protect air heating system.
	Dryer fan motor VS425, CRM-181J, CRM-91H Relays control, time and monitor fan pump motor.
	Positioning actuator VS120 Relay starts/stops actuator controlled frame/nozzle movements.
	Signal lights CRM-181J Relays control and time various signal lights.
	Soap pump motor VS120, CRM-181J, CRM-91H Relays control, time and monitor soap pump motor.
	Water heater VS120, PRI-34, CRM-181J, CRM-91H Relays control, monitor and protect water heating system.
	Water pump motor VS425, CRM-181J, CRM-91H Relays control, time and monitor water pump motor.



PRODUCT APPLICATIONS

WASTEWATER TREATMENT

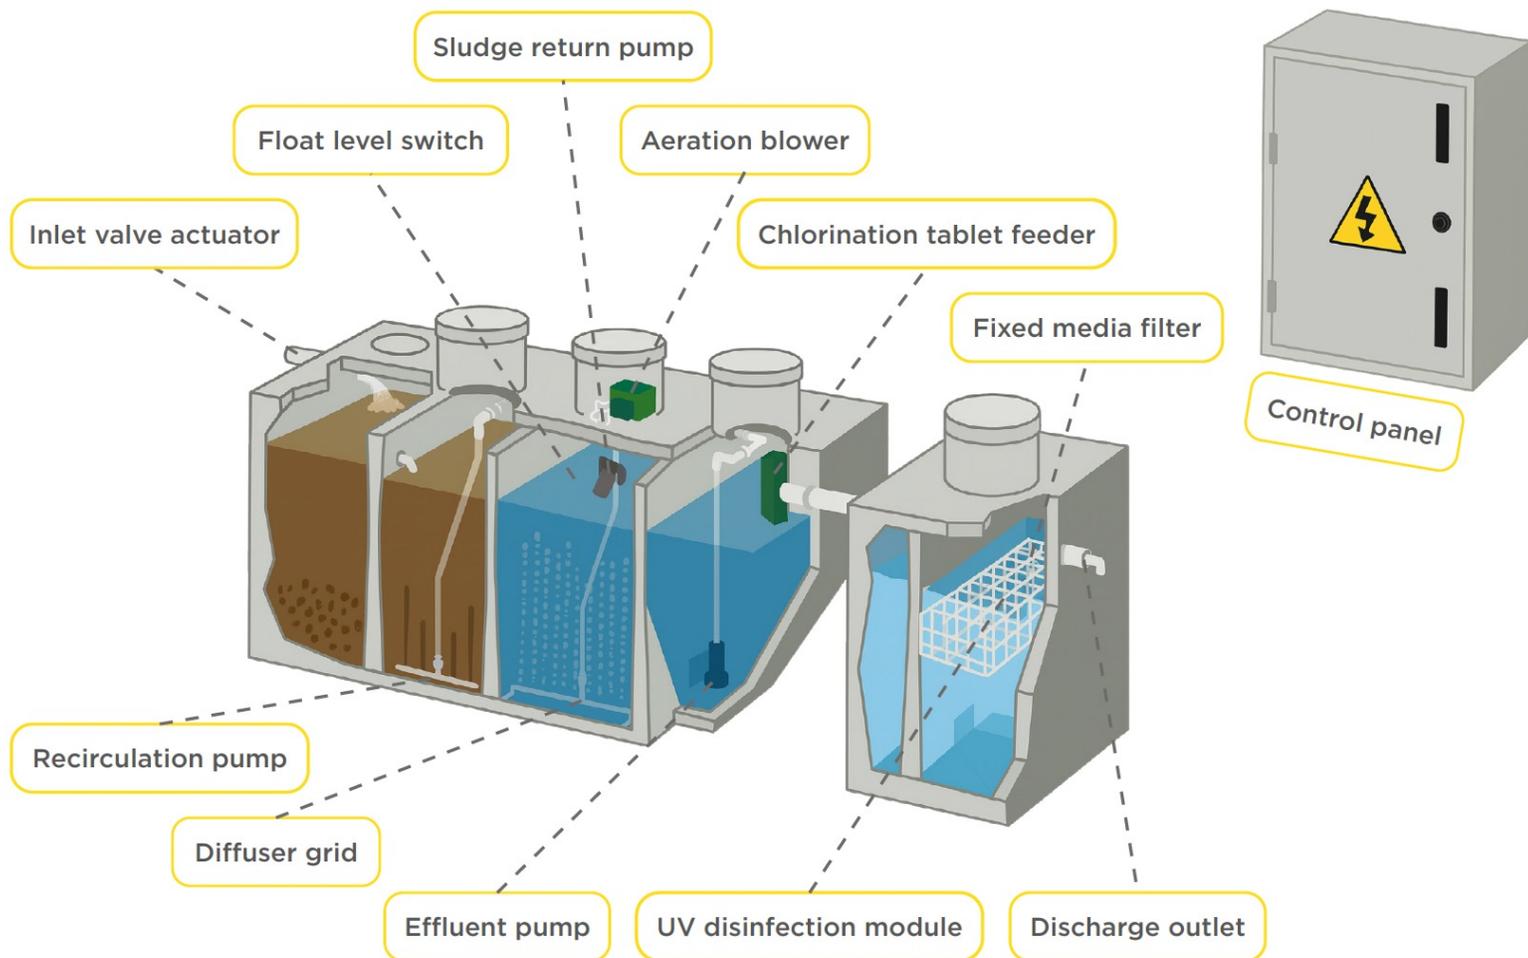

	Aeration blower CRM-91H, CRM-100H, CRM-113H Relays cycle blower operation based on timing requirements.
	Chlorination tablet feeder SHT-13, CRM-100H, CRM-113H, CRM-91H Relays activate chlorine dosing at pre-set intervals.
	Control panel VS463, HRN3-70 Contactor connects power, relay monitors voltage.
	Diffuser grid CRM-113H, CRM-100H, CRM-91H Relays alternate air pulses for grid oxygenation.
	Discharge outlet CRM-100H, CRM-113H, CRM-91H Relays release treated water based on tank level.
	Effluent pump CRM-93H, CRM-100H, CRM-113H Relays control pump discharge based on sensor input.
	Fixed media filter CRM-100H, CRM-91H, CRM-93H Relays flush media bed or redirect flow when triggered.
	Float level switch HLS-24V, HLS-230V, CRM-100H Relays respond to float position to signal fill or drain.
	Inlet valve actuator CRM-100H, CRM-91H, CRM-93H Relays open or close inlet valve according to system logic.
	Recirculation pump CRM-93H, CRM-100H, CRM-113H Relays manage timed recirculation of water between chambers.
	Sludge return pump CRM-93H, CRM-100H, CRM-91H Relays activate sludge drawdown based on schedule.
	UV disinfection module CRM-113H, CRM-100H, CRM-93H Relays power UV lamp during discharge cycles.



More Application Examples

- **Heavy industry**
- Pulp and paper
- Metal mills
- Marine and offshore applications
- Mining sites
- Oil and gas plants and stations, refineries
- LNG terminals, compressor stations
- Pumping stations



Why Choose ELKO EP North America

- quality, tradition
- reliable, easy to use products
- comprehensive product line
- qualified and responsive technical and product support
- fast lead times
- custom solutions
- assisted engineering

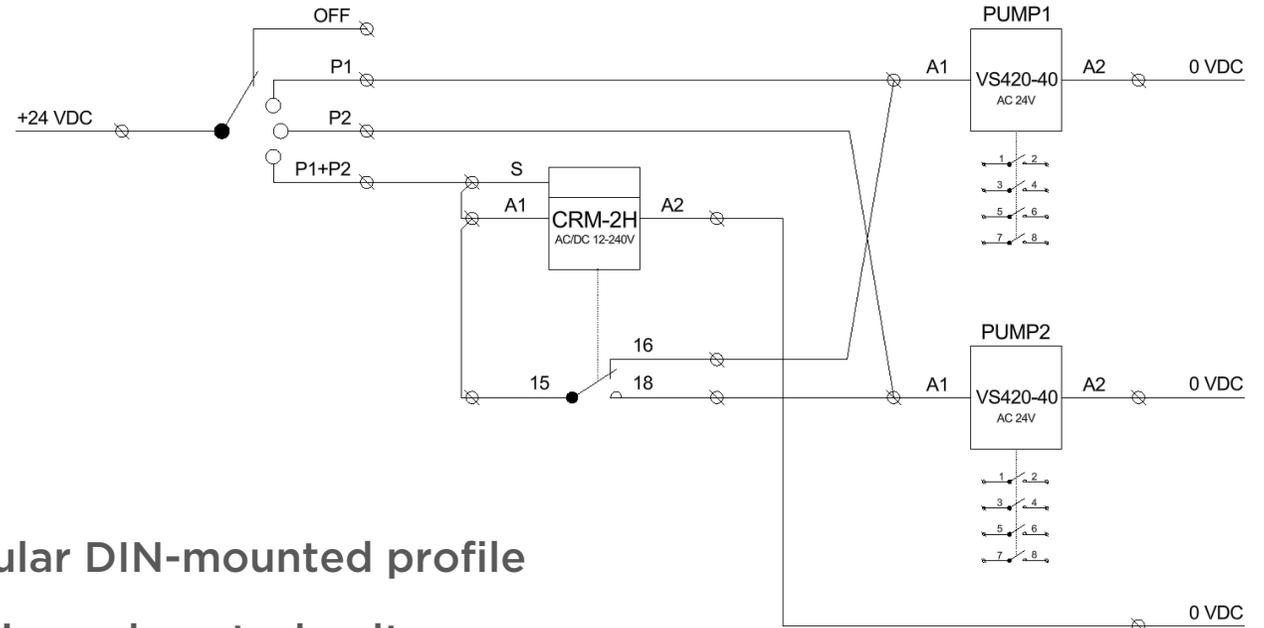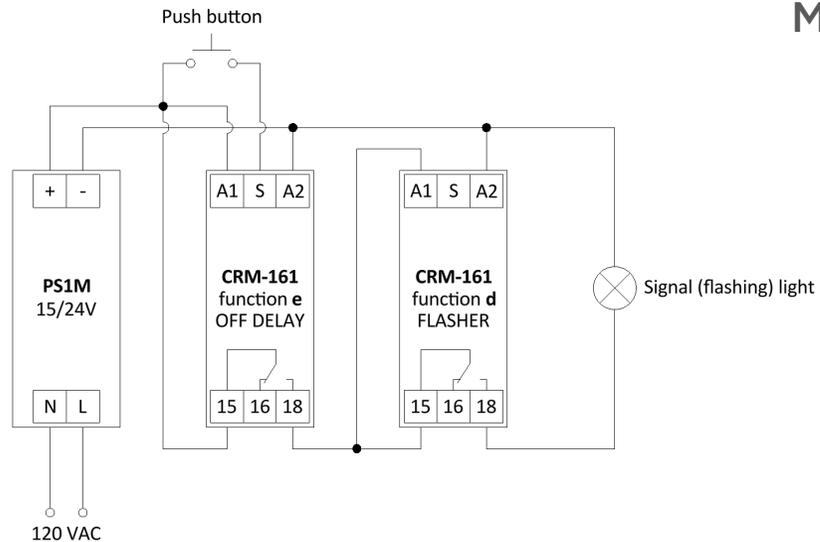

Modular DIN-mounted profile

Universal control voltage
12/24 - 240 VAC/DC





Jan Pacovsky
Managing Member, CEO

pacovsky@elkoepna.com

+1 (608) 746-1332



Milana Pabon
Logistics & Support
Director

elkosupport@elkoepna.com

+1 (602) 315-5048



Jan Hladik
Technical & Product
Director

hladik@elkoepna.com

+1 (312) 439-2098



Vaclav Rychtarik
Director of Marketing

rychtarik@elkoepna.com

+1 (904) 852-5287